

Duct/Immersion sensor Temperature

For measuring temperature in duct applications. In connection with a stainless steel or brass thermowell also applicable for pipe applications. IP65 / NEMA 4X rated enclosure.





Type Overview

Туре	Output signal	Probe length	Probe diameter
01DT-1NN	NTC10k Carel	150 mm	6 mm

Technical data

Cable entry Cable gland with strain relief ø68 m	m
Functional data Application Air Water	
Output signal passive temperature NTC10k Carel	
Measuring data Measured values Temperature	
Specification Temperature Measuring range -50150°C [-60300°F]	
Measuring current <0.2 mA @ 25°C [77°F]	
Accuracy temperature passive ±0.26°C @ 25°C [±0.48°F @ 77°F]	
Time constant τ (63%) in water pipe With thermowell A-22P-A and therm contact fluid	al
Typical 7 s with thermowell brass Typical 9 s with thermowell stainless	steel
Time constant τ (63%) in the air duct Typical 210 s @ 0 m/s Typical 46 s @ 3 m/s	
Safety data Protection class IEC/EN III, Protective Extra-Low Voltage (PEL)	/)
Power source UL Class 2 Supply	
Degree of protection IEC/EN IP65	
Degree of protection NEMA/UL NEMA 4X	
EU Conformity CE Marking	
Certification IEC/EN IEC/EN 60730-1	
Quality Standard ISO 9001	
UL Approval cULus acc. to UL60730-1A/-2-9, CAN/0 E60730-1/-2-9	<u>I</u> SA
Type of action Type 1	
Rated impulse voltage supply 0.8 kV	
Pollution degree 3	
Ambient humidity Max. 95% RH, non-condensing	
Ambient temperature -3550°C [-30122°F]	
Fluid temperature -50150°C [-60300°F]	



Technical data sheet

echnical data		
Safety data	Housing surface temperature Max. 90°C [195°F]	
Materials	Cable gland Plug Adapter: PA66, l Nut: PA6, black	black
	Housing Cover: PC, orange Bottom: PC, orange	
	Seal: NBR70, black	
	UV resistant	
	Probe material V4A (1.4404)	
Safety notes		
Â	This device has been designed for use in stationary heating, ventilati systems and must not be used outside the specified field of applicati modifications are prohibited. The product must not be used in relation that in case of a failure may threaten humans, animals or assets.	on. Unauthorised
	Ensure all power is disconnected before installing. Do not connect to live/operating equipment.	
	Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.	
	The device contains electrical and electronic components and must not be disposed of household refuse. All locally valid regulations and requirements must be observed.	
Remarks		
General remarks concerning sensors	Due to self-heating with 2 wire passive sensors, the supply wire curr measurement accuracy. So the supply current should not be higher current values specified in this data sheet.	
General remarks concerning sensors	measurement accuracy. So the supply current should not be higher	han the measuring on used), the cable he sensor used, the
	measurement accuracy. So the supply current should not be higher current values specified in this data sheet. When using lengthy connecting cables (depending on the cross sect resistance must be taken into account. The lower the impedance of t	han the measuring on used), the cable he sensor used, the
General remarks concerning sensors Parts included	measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross sect resistance must be taken into account. The lower the impedance of t greater the effect of the line resistance on the measurement, becaus	han the measuring on used), the cable he sensor used, the e it generates an offs
	measurement accuracy. So the supply current should not be higher current values specified in this data sheet. When using lengthy connecting cables (depending on the cross sect resistance must be taken into account. The lower the impedance of t	han the measuring on used), the cable he sensor used, the
Parts included	measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of to greater the effect of the line resistance on the measurement, because Description	han the measuring on used), the cable he sensor used, the e it generates an offs Type
	measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of to greater the effect of the line resistance on the measurement, because Description	han the measuring on used), the cable he sensor used, the e it generates an offs Type
Parts included Accessories	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11
Parts included Accessories	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 Type A-22D-A09
Parts included Accessories Optional accessories	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 Type A-22D-A09 A-22G-A01.1
Parts included Accessories Optional accessories	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], 	than the measuring on used), the cable he sensor used, the e it generates an offs A-22D-A11 Type A-22D-A09 A-22G-A01.1 Type
Parts included Accessories Optional accessories	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic 	than the measuring on used), the cable he sensor used, the e it generates an offs A-22D-A11 A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03
Parts included Accessories Optional accessories air	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 Type A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A05 Type A-22P-A10
Parts included Accessories Optional accessories air	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 Thermowell Brass, 150 mm, R 1/2", SW22 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A05 Type A-22P-A10 A-22P-A10 A-22P-A22
Parts included Accessories Optional accessories air	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 Thermowell Brass, 150 mm, R 1/2", SW22 Syringe with thermal paste 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22P-A10 A-22P-A10 A-22P-A22 A-22P-A44
Parts included Accessories Optional accessories air	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 Thermowell Brass, 150 mm, R 1/2", SW22 Syringe with thermal paste Compression fitting, Stainless steel, G 1/4" (external thread) for 6 mm 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22P-A10 A-22P-A10 A-22P-A22 A-22P-A44
Parts included Accessories Optional accessories air	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of the greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 Thermowell Brass, 150 mm, R 1/2", SW22 Syringe with thermal paste 	than the measuring on used), the cable he sensor used, the e it generates an offs Type A-22D-A11 A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22P-A10 A-22P-A10 A-22P-A22 A-22P-A44
Parts included Accessories Optional accessories included	 measurement accuracy. So the supply current should not be higher to current values specified in this data sheet. When using lengthy connecting cables (depending on the cross section resistance must be taken into account. The lower the impedance of to greater the effect of the line resistance on the measurement, because Description Mounting clip, with screws and adhesive foil Description Mounting plate S housing Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs. Description Mounting flange for sensor probe 6 mm, up to max. 120°C [248°F], Plastic Mounting flange for sensor probe 6 mm, up to max. 260°C, Brass Description Thermowell Stainless steel, 150 mm, G 1/2", SW27 Thermowell Brass, 150 mm, R 1/2", SW22 Syringe with thermal paste Compression fitting, Stainless steel, G 1/4" (external thread) for 6 mm with cutting ring 	than the measuring on used), the cable he sensor used, the e it generates an offs A-22D-A11 A-22D-A11 A-22D-A09 A-22G-A01.1 Type A-22D-A03 A-22D-A03 A-22D-A03 A-22D-A03 A-22P-A10 A-22P-A10 A-22P-A10 A-22P-A10 A-22P-A44 n, A-22P-A45





- · · ·				
Techn	ical	dat	ta si	heet
- CCIIII	licui	uu	u J	neec

01DT-1N..

Description	Туре
Adapter for Siemens thermowell	A-22P-A53

Wiring diagram

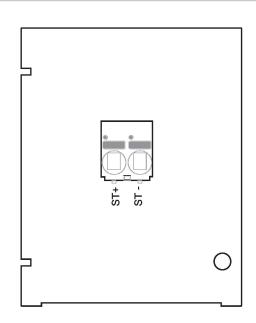






Dimensions



01DT-1N..

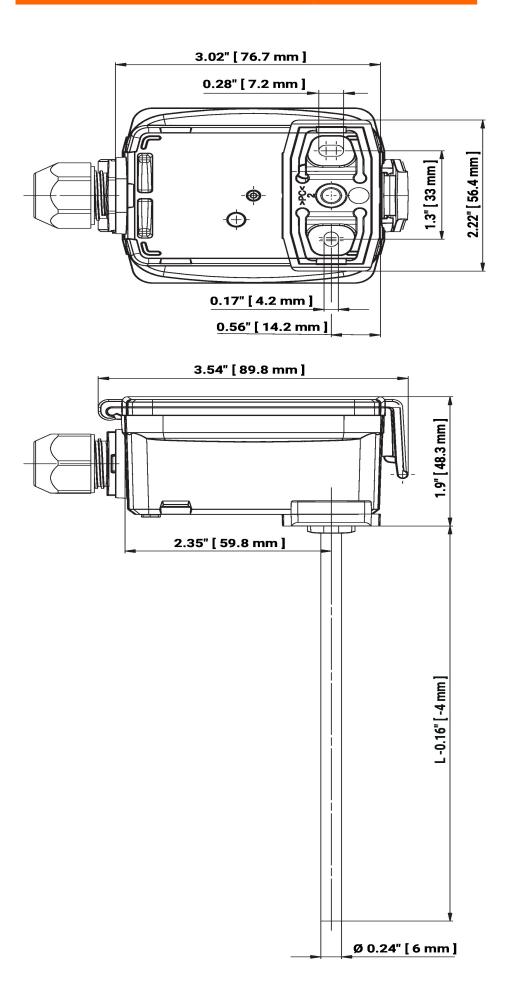



Dimensions

L = Probe length

Туре	Probe length	Weight
01DT-1NN	150 mm	0.12 kg

Further documentation

- Installation instructions
- Resistance characteristics
- Sensor length calculator