



BACnet Interface Description



Differential pressure sensors air 22ADP-..5..

Edition 2024-08 / V4.1

Content

Protocol Implementation Conformance Statement – PICS

General information	
BACnet Interoperability Building Blocks supported (BIBBs)	3
BACnet MS/TP	
Standard object types supported	4

Operating elements for addressing and parametrisation

RS 485 module	
Functions of DIP switch 1 and DIP switch 2	5
LED functions	

BACnet object description

Sensor values	6–7
Offset and correction values	8
Upper / lower limit of measuring values	9–10
Selection of sensor channels of measuring values	11
Sensor configuration	12–13
General device information	13
LCD-display configuration	14

Protocol Implementation Conformance Statement – PICS

General information

Date	02.08.2022
Vendor Name	BELIMO Automation AG
Vendor ID	423
Product Name	Sensor
Product Model Number	22ADP-16.. 22ADP-56..
Application Software Version	2.3
Firmware Revision	2.3
BACnet Protocol Revision	1.14
Product Description	BACnet Smart sensor (B-SS)
BACnet Standard Device Profile	BACnet Application Specific Controller (B-ASC)
Segment Capability	No
Data Link Layer Options	MS/TP Manager
Device Addressing Binding	No static device binding supported
Networking Options	None
Character Sets Supported	UTF-8

BACnet Interoperability Building Blocks supported (BIBBs)

Data sharing – ReadProperty-B (DS-RP-B)
 Data sharing – ReadPropertyMultiple-B (DS-RPM-B)
 Data sharing – WriteProperty-B (DS-WP-B)
 Data sharing – COV Unsubscribed-B (DS-COVU-B)
 Device management – DynamicDeviceBinding-B (DM-DDB-B)
 Device management – DynamicObjectBinding-B (DM-DOB-B)
 Device management – DeviceCommunicationControl-B (DM-DCC-B)

BACnet MS/TP

Baud Rates	9'600, 19'200, 38'400, 76'800
Number of Nodes	Max. 32 (without repeater)



Depending on the sensor type and the version, not all the measured values and configuration parameters listed in this document are available. The values available for the respective sensor, can be taken from the respective sensor data sheet, or via the "Out of Service" flag of the corresponding object via BACnet.

Standard object types supported

Object processing

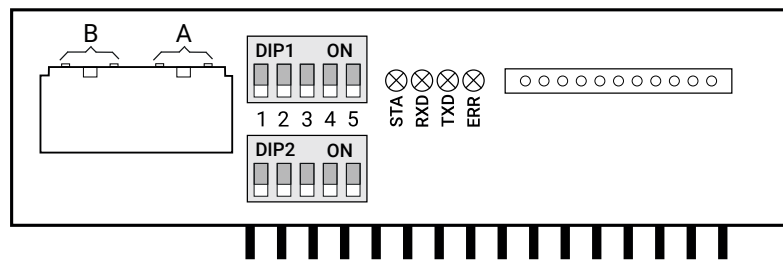
Object type	Optional properties	Writeable properties
Device	Description Max Manager Max Info Frames	Description
Analog Input [AI]	Description COV Increment	COV Increment
Analog Value [AV]	Description	Present Value
Binary Input [BI]	Description Active Text Inactive Text	–
Binary Value [BV]	Description Active Text State Text	Present Value
Multi-state Value [MV]	Description State Text	Present Value

The specified maximum length of writable strings in the Device Object are based on single byte characters and support up to 32 characters.

Operating elements for addressing and parametrisation

RS 485 module

In addition to the basic board, each BACnet sensor is equipped with a RS-485 module. The BACnet communication lines A (D +) and B (D -) are connected to the module. Furthermore, on the two DIP switches, the MAC address of the BACnet sensor can be selected and the communication parameters can be set.

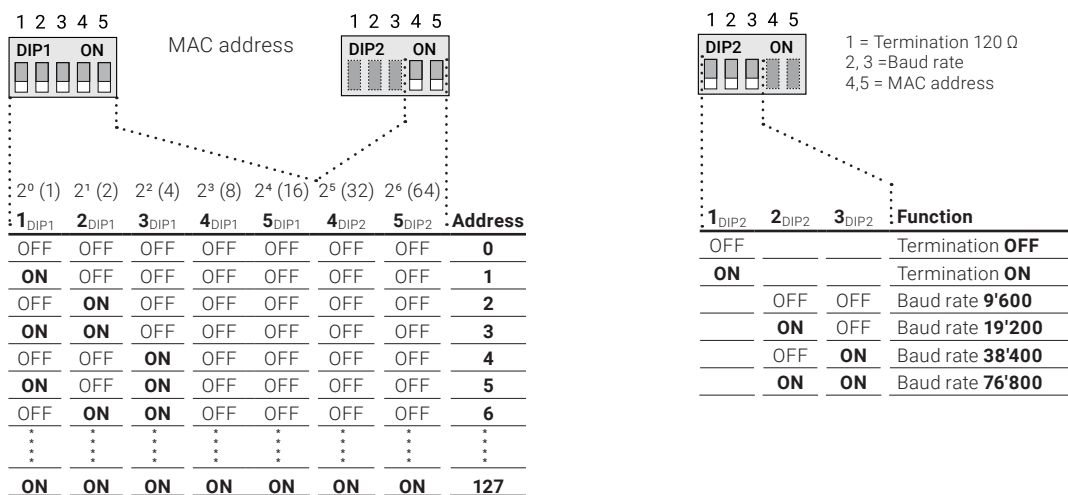


Functions of DIP switch 1 and DIP switch 2

DIP switch **DIP1** (switch 1–5) is used to set the MAC address together with switch **DIP2** (switch 4 and 5) binary coded in a range of 1...127 (Address 0 is reserved and can't be set).

DIP switch **DIP2** (switch 1, 2, 3) is used to parametrise termination (120 Ω) and baud rate.

All DIP switches are factory set to the OFF position.



LED functions

The four LEDs on the RS-485 module show the actual operating status of the RS-485 module.

STA During normal operation the LED is flashing.
LED is turned ON during sensor initialization after Power ON of the device.

RXD LED is turned ON if bus telegrams are received by the RS-485 module.

TXD LED is turned ON if bus telegrams are sent by the RS-485 module.

ERR LED is turned ON in case of a faulty bus configuration or in case of internal errors.

BACnet object descriptions



Information



Depending on the device type or version, not all measured values or configuration parameters listed in this document are available. Which values are available for your device can be found in the relevant device data sheet, or via the "Out of Service" flag of the corresponding object via BACnet.

Sensor values

Via the objects analog inputs AI[0]...AI[11] the various sensor measuring values can be read out.

→ Selection of unitary system SI or Imperial see description of object analog value AV[38].

Object type [Instance]	Description Comment, Status_Flags	COV increment	Values	Access
Device [x]	Device Object	–	–	R
AI[0]	Not supported on this device type	–	–	–
AI[1]	Not supported on this device type	–	–	–
AI[2]	Not supported on this device type	–	–	–
AI[3]	Not supported on this device type	–	–	–
AI[4]	Not supported on this device type	–	–	–
AI[5]	Not supported on this device type	–	–	–
AI[6]	Not supported on this device type	–	–	–
AI[7]	Not supported on this device type	–	–	–
	Differential pressure 1			
AI[8]	Selection Pa (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP Selection inchWC (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP		0...7'000 Pa [0...28 inchWC]	According to measuring range 22ADP (DIP switch) R
	Volumetric flow 1			
AI[9]	Selection m³/h (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP If object analog value AV[41] is set to 0 or 1 a value in m³/h is shown. If object analog value AV[41] is set to 2 a value in m³/s is shown. Selection cfm (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP		0...999'999 m³/s 0...999'999 m³/h [0...999'999 cfm]	0...999'999 m³/s 0...999'999 m³/h [0...999'999 cfm] R



Object type [Instance]	Description Comment, Status_Flags	COV increment	Values	Access
AI[10]	<p>Differential pressure 2 (@dual ADP only) Selection Pa (SI) via 6th DIP switch (OFF) of sensor main board 22ADP</p> <p>cfm m³/s m³/h</p>  <p>Inch WC (Imperial) Pa (SI)</p> <p>S2</p>	0...7'000 Pa [0...28 inWC]	According to measuring range 22ADP (DIP switch)	R
AI[11]	<p>Volumetric flow 2 (@dual ADP only) Selection m³/h (SI) via 6th DIP switch (OFF) of sensor main board 22ADP</p> <p>If object analog value AV[41] is set to 0 or 1 a value in m³/h is shown. If object analog value AV[41] is set to 2 a value in m³/s is shown.</p> <p>cfm m³/s m³/h</p>  <p>Inch WC (Imperial) Pa (SI)</p> <p>S2</p>	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm]	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm]	R
	<p>Selection cfm (Imperial) via 6th DIP switch (ON) of sensor main board 22ADP</p>			

Description Access: R = Read, W = Write

Offset and correction values

Via the objects analog outputs AV[0]...AV[5] offset and correction values for the individual measuring values can be defined.

→ Selection of unitary system SI or Imperial see description of object analog value AV[38].

Object type [Instance]	Description Comment, Status_Flags	Values	Access	
AV[0]	Not supported on this Device Type	–	–	
AV[1]	Not supported on this Device Type	–	–	
AV[2]	Not supported on this Device Type	–	–	
AV[3]	Not supported on this Device Type	–	–	
Offset Differential pressure 1 Selection Pa (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP				
AV[4]	Selection inchWC (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP. The values for inchWC are given in 1000ths. For example, to set the value 0.01 inchWC, 10 (1000*0.01 inchWC) must be written.	 S1	-50 Pa...+50 Pa [-0.2 inchWC...+0.2 inchWC]	R / W
Offset Differential pressure 2 (@dual ADP only) Selection Pa (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP				
AV[5]	Selection inchWC (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP. The values for inchWC are given in 1000ths. For example, to set the value 0.01 inchWC, 10 (1000*0.01 inchWC) must be written.	 S2	-50 Pa...+50 Pa [-0.2 inchWC...+0.2 inchWC]	R / W

Description Access: R = Read, W = Write




Upper / lower limit of measuring values

Via the objects analog outputs AV[6]...AV[25] upper / lower limits of measuring values can be set in a certain range.

Furthermore the scaling of the two analogue 0–10 V outputs of the sensor are defined via these objects analog outputs.

→ Selection of unitary system SI or Imperial see description of object analog value AV[38].


Object type [Instance]	Description Comment, Status_Flags	Values	Access
AV[6]	Not supported on this Device Type	–	–
AV[7]	Not supported on this Device Type	–	–
AV[8]	Not supported on this Device Type	–	–
AV[9]	Not supported on this Device Type	–	–
AV[10]	Not supported on this Device Type	–	–
AV[11]	Not supported on this Device Type	–	–
AV[12]	Not supported on this Device Type	–	–
AV[13]	Not supported on this Device Type	–	–
AV[14]	Not supported on this Device Type	–	–
AV[15]	Not supported on this Device Type	–	–
AV[16]	Not supported on this Device Type	–	–
AV[17]	Not supported on this Device Type	–	–
AV[18]	Not supported on this Device Type	–	–
AV[19]	Not supported on this Device Type	–	–
AV[20]	Not supported on this Device Type	–	–
AV[21]	Not supported on this Device Type	–	–
	Lower limit volumetric flow 1 Selection m ³ /h (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP.		
AI[22]	If object analog value AV[41] is set to 0 or 1 a value in m ³ /h is shown. If object analog value AV[41] is set to 2 a value in m ³ /s is shown.	cfm m ³ /s m ³ /h	R / W
		Inch WC (Imperial) Pa (SI)	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm]
	Selection cfm (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP	S1	

Object type [Instance]	Description	Values	Access
	Upper limit volumetric flow 1 Selection m ³ /h (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP		
AI[23]	If object analog value AV[41] is set to 0 or 1 a value in m ³ /h is shown. If object analog value AV[41] is set to 2 a value in m ³ /s is shown. Selection cfm (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP	 cfm m ³ /s m ³ /h Inch WC (Imperial) Pa (SI) S1	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm] R / W
	Lower limit volumetric flow 2 (@dual ADP only) Selection m ³ /h (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP.		
AI[24]	If object analog value AV[41] is set to 0 or 1 a value in m ³ /h is shown. If object analog value AV[41] is set to 2 a value in m ³ /s is shown. Selection cfm (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP	 cfm m ³ /s m ³ /h Inch WC (Imperial) Pa (SI) S2	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm] R / W
	Upper limit volumetric flow 2 (@dual ADP only) Selection m ³ /h (SI) via 6 th DIP switch (OFF) of sensor main board 22ADP		
AI[25]	If object analog value AV[41] is set to 0 or 1 a value in m ³ /h is shown. If object analog value AV[41] is set to 2 a value in m ³ /s is shown. Selection cfm (Imperial) via 6 th DIP switch (ON) of sensor main board 22ADP	 cfm m ³ /s m ³ /h Inch WC (Imperial) Pa (SI) S2	0...999'999 m ³ /s 0...999'999 m ³ /h [0...999'999 cfm] R / W

Description Access: R = Read, W = Write


Limit differential pressure 1 + 2

Pressure range can be set with DIP switch 1–3 of sensor main board 22ADP. For the specific values, please refer to the product data sheet of the respective device.




Selection of **Pa** via 6th DIP switch (OFF) of sensor main board 22ADP.

S1 + S2



Pa
(m³/h)

Selection **InchWC** via 6th DIP switch (ON) of sensor main board 22ADP.



Inch WC
(cfm)

Selection of sensor channels of measuring values

Via objects analog outputs AV[26]...AV[37] the individual measured values can be assigned to channels. This can be used to assign the two analog outputs to the corresponding measured value (channel # 1 = AOU1, channel # 2 = AOU2). In addition, 4 fields of the LCD display (optional) can be assigned to measured values by using the corresponding channel #.

Default settings	Object type [Instance]	Description	Access
Channel temperature	Default value channel#		
Not supported on this device type	–	AV[26]	–
Channel relative humidity	Default value channel#		
Not supported on this device type	–	AV[26]	–
Channel absolute humidity	Default value channel#		
Not supported on this device type	–	AV[28]	–
Channel enthalpy	Default value channel#		
Not supported on this device type	–	AV[29]	–
Channel dew point	Default value channel#		
Not supported on this device type	–	AV[30]	–
Channel CO₂	Default value channel#		
Not supported on this device type	–	AV[31]	–
Channel VOC	Default value channel#		
Not supported on this device type	–	AV[32]	–
Channel CO₂ VOC Mix	Default value channel#		
Not supported on this device type	–	AV[33]	–
Channel differential pressure 1	Default value channel#		
Sensor 22ADP-..6..	1 (AOU1)	AV[34]	R / W
Sensor 22ADP-..6.. (dual aDP)	1 (AOU1)		
Channel volumetric flow 1	Default value channel#		
Sensor 22ADP-..6..	2 (AOU2)	AV[35]	R / W
Sensor 22ADP-..6.. (dual aDP)	3		
Channel differential pressure 2	Default value channel#		
Sensor 22ADP-..6..	0	AV[36]	R / W
Sensor 22ADP-..6.. (dual aDP)	2 (AOU2)		
Channel volumetric flow 2	Default value channel#		
Sensor 22ADP-..6..	0	AV[37]	R / W
Sensor 22ADP-..6.. (dual aDP)	4		

Channel Selection #
Valid values 1, 2, 3 or 4
The channels with channel #1 and #2 are output both via BACnet objects analog inputs AI[0]...AI[9] and via the analog outputs AOU1 and AOU2.

4 fields of the LCD-display (optional) can be assigned to measured values by using the corresponding channel #.

Unused channels are set to zero.

Assignment:
LCD fields to channel #

Field 1 (channel 1)	Field 3 (channel 3)
Field 2 (channel 2)	Field 4 (channel 4)

Example →

dp	Flow
Pa	m ³ /h
dp	Flow
Pa	m ³ /h


Description Access: R = Read, W = Write

Channel Selection # Valid values 1, 2, 3 or 4

The channels with channel #1 and #2 are output both via BACnet and via the analog outputs AOU1 and AOU2. **4 fields of the LCD display** (optional) can be assigned to measured values by using the corresponding channel #.

Sensor configuration

Via objects analog outputs AV[38]...AV[44] the required unitary system (SI or Imperial) can be selected and further. Sensor parameters can be chosen.

Object type [Instance]	Description Comment, Status_Flags	Values	Access
	Selection of the unitary system (SI or Imperial)		
AV[38]	<p>Note: For sensors with differential pressure / volumetric flow (22ADP), this value is only readable and is instead set via the 6th DIP switch (ON = Imperial / OFF = SI)</p> 	cfm m ³ /s m ³ /h Inch WC (Imperial) Pa (SI)	1 = SI 2 = Imperial R / W
AV[39]	Height above sea level Input always in m and not in ft	1...5000 m 330 (default)	R / W
AV[40]	Input k-factor volumetric flow 1 According to manufacturer's (without unit)	scaling factor: 0.1 Input: 3...50'000 15'000 (default) k-value: 0.3...5'000	R / W
AV[41]	Selection off the fan manufacturer 1, volumetric flow (The fan model has influence on the formula to calculate the volumetric flow)	Rosenberg Comefri Gebhart Nicotra Ziehl-Abegg EBM-Papst AIR-CONCEPTS Fläkt-Woods	0 (Default) 1 2 R / W
AV[42]	Input k-factor volumetric flow 2 (@dual ADP only) According to manufacturer's (without unit)	scaling factor: 0.1 Input: 3...50'000 15'000 (default) k-value: 0.3...5'000	R / W
AV[43]	Selection off the fan manufacturer, volumetric flow 2 (@dual ADP only) (The fan model has influence on the formula to calculate the volumetric flow) [Default value = 0]	Rosenberg Comefri Gebhart Nicotra Ziehl-Abegg EBM-Papst AIR-CONCEPTS Fläkt-Woods	0 (Default) 1 2 R / W
AV[44]	Response time for volumetric flow 1	4...30 s	R / W
AV[45]	Response time for volumetric flow 2 (@dual ADP only)	4...30 s	R / W
..	-	-	-
AV[85]	Zeroing differential pressure 1	0 = No zeroing 1 = Start zeroing	R / W
AV[86]	Zeroing differential pressure 2 (@dual ADP only)	0 = No zeroing 1 = Start zeroing	R / W

Description Access: R = Read, W = Write

Equations of manufacturers

Each manufacturer has its own Equation, k-factor range and unit of Equation (see tables). By selecting a manufacturer AV[41] / AV[43] and corresponding plant-specific k-factor AV[40] / AV[42] correct settings for each manufacturer will be automatically in use.

Note: If the unitary system is set to Imperial the output is shown in objects analog input AI[9] in cfm

Manufacturer	Equation	k factor range	Unit	Manufacturer	Equation	k factor range	Unit
Fläkts Woods	$q = \frac{1}{k} \cdot \sqrt{\Delta P}$	0.3...99	m ³ /s	Ziehl-Abegg	$q = k \cdot \sqrt{\Delta P}$	10...1500	m ³ /h
Rosenberg	$q = k \cdot \sqrt{\frac{2 \cdot \Delta P}{\rho}}$	37...800	m ³ /h	Comefri	$q = k \cdot \sqrt{\frac{2 \cdot \Delta P}{\rho}}$	10...2000	m ³ /h
Nicotra-Gebhardt	$q = CPFN \cdot \sqrt{\frac{2 \cdot \Delta P}{\rho}}$	10...1500	m ³ /h	EBM - Papst	$q = k \cdot \sqrt{\Delta P}$	10...1500	m ³ /h
				Gebhardt	$q = k \cdot \sqrt{\frac{2 \cdot \Delta P}{\rho}}$	50...4700	m ³ /h

General device information

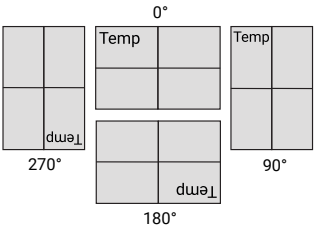


Via objects analog outputs AV[46]...AV[51] general device information can be read out or can be written.

Object type [Instance]	Object type [Instance]	Values	Access
AV[46]	Offset device ID Valid range: 0...4'194'175 Device ID = Offset device ID + MAC address	–	R / W
AV[47]	Unconfirmed COV	0 = Disabled 1 = Enabled	R / W
AV[48]	Minimum output voltage in volt	0...10 V	R / W
AV[49]	Operating hours [h]	uint32_t (0...4'294'967'295)	R / W
AV[50]	Set a maintenance time in hours [h] after which sensor shall be checked: After countdown time has expired a new countdown value in hours [h] has to be set.	uint32_t (0...999'999 h)	R / W
AV[50]	Set a maintenance time in hours [h] after which sensor shall be checked: After countdown time has expired a new countdown value in hours [h] has to be set.	uint32_t (0...999'999 h)	R / W

Description Access: R = Read, W = Write

LCD-display configuration

Via objects analog outputs AV[52]...AV [67] display parameters of the optional LCD can be adjusted and the values to be displayed can be specified.

Object type [Instance]	Object type [Instance]	Values	Access
AV[52]	Enable LCD	0 = Disabled 1 = Enabled	R / W
AV[53]	Brightness LCD	0...100%	R / W
AV[54]	Rotation LCD	 <p>0 = 0° 1 = 90° 2 = 180° 3 = 270°</p>	R / W
AV[55]	Enable LCD traffic light function	0 = Disabled 1 = Enabled	R / W
AV[56]	Enable symbol maintenance on LCD If the countdown time set value of AV[50] has expired, the symbol will be shown on the LCD-display.	 0 = Disabled 1 = Enabled	R / W
AV[57]	Enable symbol symbol maintenance on LCD If the countdown time set value of AV[50] has expired, the symbol will be shown on the LCD-display.	 0 = Disabled 1 = Enabled	R / W
AV[58]	Enable LCD channel 1	0 = Disabled 1 = Enabled	R / W
AV[59]	Enable LCD channel 2	0 = Disabled 1 = Enabled	R / W
AV[60]	Enable LCD channel 3	0 = Disabled 1 = Enabled	R / W
AV[61]	Enable LCD channel 4	0 = Disabled 1 = Enabled	R / W
AV[62]	Channel assignment for traffic light function Input AV[26] to AV[35] (Example: channel temperature AV[26])	0 = Off 1 = Green 2 = Yellow 3 = Red 4 = Blue 5 = Magenta 6 = Cyan 7 = White	R / W
AV[63]	Traffic light function color range 1 Definition of color of LCD back lightning	0 = Off 1 = Green 2 = Yellow 3 = Red 4 = Blue 5 = Magenta 6 = Cyan 7 = White	R / W
AV[64]	Traffic light function color range 1 Definition of color of LCD back lightning	0 = Off 1 = Green 2 = Yellow 3 = Red 4 = Blue 5 = Magenta 6 = Cyan 7 = White	R / W
AV[65]	Traffic light function color range 1 Definition of color of LCD back lightning	0 = Off 1 = Green 2 = Yellow 3 = Red 4 = Blue 5 = Magenta 6 = Cyan 7 = White	R / W
AV[66]	Setting for threshold (range 1 → 2) For color change of LCD back lightning. The value input is done in the basic unit based on the value of objects analog inputs AI[0]...AI[9]	–	R / W
AV[67]	Setting for threshold (range 1 → 2) For color change of LCD back lightning. The value input is done in the basic unit based on the value of objects analog inputs AI[0]...AI[9]	–	R / W

Description Access: R = Read, W = Write

All inclusive.

Belimo as a global market leader develops innovative solutions for the controlling of heating, ventilation and air-conditioning systems. Damper actuators, control valves, sensors and meters represent our core business.

Always focusing on customer value, we deliver more than only products. We offer you the complete product range for the regulation and control of HVAC systems from a single source. At the same time, we rely on tested Swiss quality with a five-year warranty. Our worldwide representatives in over 80 countries guarantee short delivery times and comprehensive support through the entire product life. Belimo does indeed include everything.

The "small" Belimo devices have a big impact on comfort, energy efficiency, safety, installation and maintenance.

In short: Small devices, big impact.



5-year warranty



On site around the globe



Complete product range



Tested quality



Short delivery times



Comprehensive support



BELIMO Automation AG

Brunnenbachstrasse 1, 8340 Hinwil, Switzerland

+41 43 843 61 11, info@belimo.ch, www.belimo.com

